


LEGEND

NOTES

- DRAWING IS FOR INDICATIVE PURPOSES ONLY AND SHALL BE FINALIZED IN THE NEXT STAGE OF DESIGN.
- ALL DIMENSIONS ARE IN METERS UNLESS STATED OTHERWISE.
- POWERHOUSE CAVERN AND CABLE GALLERY LINING THICKNESS IS SUBJECT TO ROCK SUPPORT DESIGN AT THE NEXT STAGE OF DESIGN. MINIMUM THICKNESS OF 0.4m SHOWN INDICATIVELY.
- THE PARTITION WALL THICKNESS IS SUBJECT TO STRUCTURAL DESIGN AT THE NEXT STAGE OF DESIGN. MINIMUM THICKNESS OF 0.5m SHOWN INDICATIVELY.
- MAIN INLET VALVE IS SHOWN INDICATIVELY. CONNECTION DETAILS TO BE SPECIFIED AT THE NEXT STAGE OF DESIGN.



APPROVED FOR ISSUE

A	HY	TP
I/R	DRAWN BY	CHECKED
		APPROVED

ISSUE/REVISION


A	JULY 2024	FINAL
I/R	DATE	DESCRIPTION

SHEET TITLE

INDICATIVE POWER CAVERN SECTION

FIGURE NUMBER

FIGURE 2.12

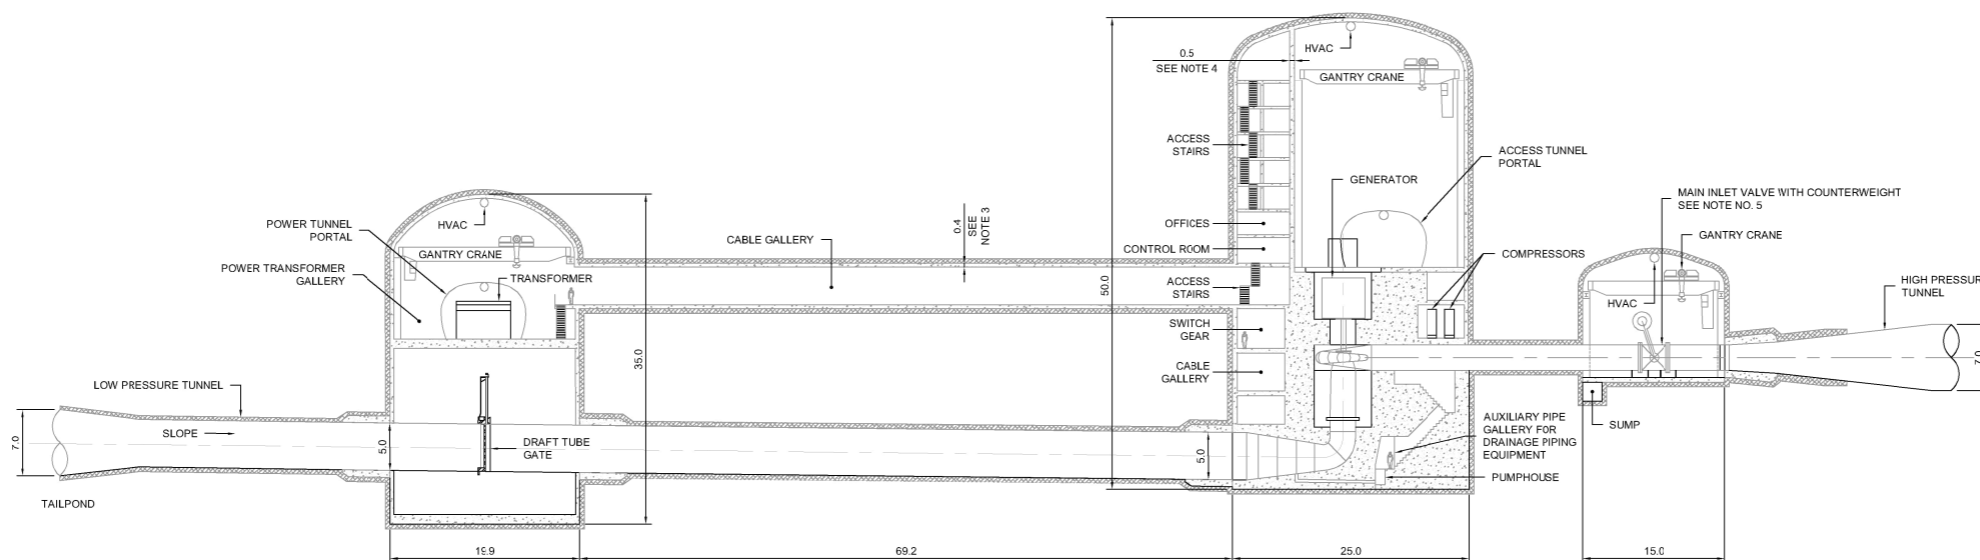

A | POWERHOUSE UNIT SECTION

SCALE 1:400m

NOT FOR CONSTRUCTION
FOR INFORMATION ONLY

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.